

Sound absorption coefficient ISO 354

Measurement of sound absorption in reverberation rooms

Client: Artimo Textiles BV
De Meeten 53, 4706 NK, Roosendaal The Netherlands

Test specimen: Mute CS

Fabric:

Information provided by the client

- designation: **Mute CS**
- material: 92 % PES (Trevira CS), 8 % PES
- area specific mass $m'' = 140.2 \text{ g/m}^2$

Information provided by testing laboratory

(determined at one sample of the curtain, dimensions 210 mm x 297 mm)

- thickness $t = 0.44 \text{ mm}$
- airflow resistance $R_s = 143 \text{ Pa s/m}$

Test arrangement:

- style of type G-100 mounting acc. to DIN EN ISO 354
- arranged as a pleated curtain with 100 % fullness hanging in front of a reflecting wall
- fixed directly underneath the ceiling of the reverberation room, suspended from a metal rail (height 90 mm, overlap 60 mm), distance to the back wall 100 mm
- test arrangement without enclosing frame
- factory-made ready-for-use curtain splice width x height = 7000 mm x 3030 mm
- test surface width x height = 3.50 m x 2.97 m (starting at the lower edge of the metal rail)

Room: E


Volume: 199.60 m³

Size: 10.40 m²

Date of test: 2023-10-19

	θ [°C]	$r. h.$ [%]	B [kPa]
without specimen	20.7	45.4	93.3
with specimen	20.7	44.9	93.3

Frequency [Hz]	α_s 1/3 octave	α_p octave
100	0.08	0.10
125	0.10	
160	0.17	
200	0.23	0.30
250	0.31	
315	0.38	
400	0.43	0.50
500	0.50	
630	0.52	
800	0.56	0.55
1000	0.54	
1250	0.53	
1600	0.55	0.55
2000	0.58	
2500	0.59	
3150	0.63	0.65
4000	0.65	
5000	0.65	

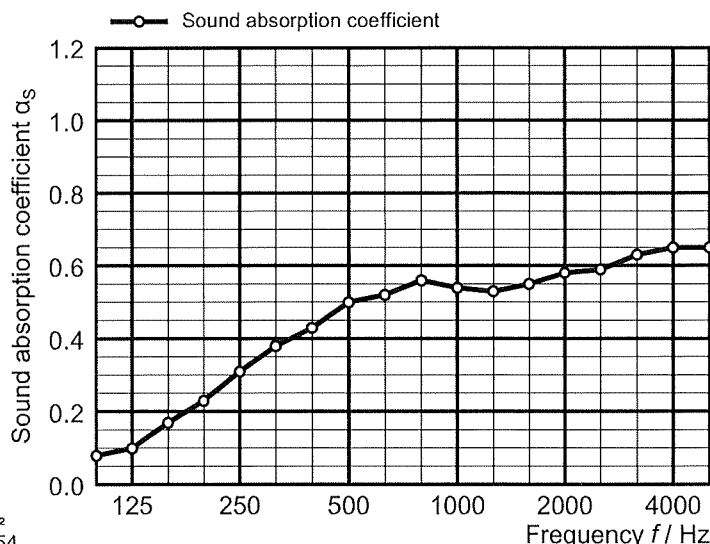

◦ Equivalent sound absorption area less than 1.0 m²
 α_s Sound absorption coefficient according to ISO 354
 α_p Practical sound absorption coefficient according to ISO 11654

Rating according to ISO 11654: Weighted sound absorption coefficient $\alpha_w = 0.55$ Sound absorption class: D	Rating according to ASTM C423: Noise Reduction Coefficient $NRC = 0.50$ Sound Absorption Average $SAA = 0.48$
--	---

M Ü L L E R - B B M

Planegg, 2024-01-10

No. of test report B106822/66

Appendix A

Page 1

\\s-nuc-fs01\allefirmen\B\Proj\106\B106822\B106822_66_PBE_1E.DOCX:22. 01. 2024