

Test laboratory for the fire behavior of building materials, Dipl.-Ing. (FH) Andreas Hoch
Testing, supervising and certifying body, authorized by the building supervision authority

TEST REPORT PZ-Hoch-241603

for the proof of Fire behaviour according to DIN 4102, part 1

Translation of the German test report – no guarantee for translation of technical terms

company	Artimo Textiles De Meeten 53 4706 NK Roosendaal The Netherlands
description of samples	fabric consisting of 100% polyester FR, in 3 different colours
name of the material	RODIN
sampling	by the company itself
content of request	Proof of flammability to classify building materials to class B1 "schwerentflammbar" according to DIN 4102, part 1
validity of test report	30.11.2029
result	The examined product meets in any colour the requirements of class B1 for "schwerentflammbare" (hardly flammable) building materials according to DIN 4102, part 1 (May 1998), suspended freely or with distance of >40 mm to same or other plain materials.

This test report includes 5 pages and 7 enclosures.

Remark: If the above mentioned building material is not used as product according to MBO § 2, Abs. 9, Ziffer1, there is no need for a general building supervisory test report.

This test report is not valid if the examined building material is used as product in the meaning of state building prescriptions (MBO § 17, Abs. 3).

This test report does not replace an eventually necessary proof of applicability concerning building supervisory or building laws in the meaning of state building prescriptions. This has to be verified by:

- "allgemeine bauaufsichtliche Zulassung" (general building inspectorate approval) or by
- „allgemeines bauaufsichtliches Prüfzeugnis" (general building inspectorate certificate) or by
- "Zustimmung im Einzelfall" (exceptional approval)

This test report can underlie building supervisory procedures

- for regular building products for the prescribed proofs of conformity
- for non-regular building products for the needed proofs of applicability.

This test report must not be published and copied without preceding agreement of the test laboratory and if agreed, only during validity and unchanged concerning appearance and contents.



Prüfinsitut Hoch
 Lerchenweg 1
 D-97650 Fladungen

1. Description of test material in condition as delivered

PN 38404: RODIN colour: blue
 -fabric consisting of 100% polyester FR-
 side A: surface with fine weaving structure
 characteristic values determined by the test laboratory:
 area weight: about 391 g/m² thickness: about 0,99 mm

PN 40068: RODIN colour: white
 -fabric consisting of 100% polyester FR-
 side B: surface with fine weaving structure
 characteristic values determined by the test laboratory:
 area weight: about 391 g/m² thickness: about 0,88 mm

PN 40069: RODIN colour: red
 -fabric consisting of 100% polyester FR-
 side B: surface with fine weaving structure
 characteristic values determined by the test laboratory:
 area weight: about 436 g/m² thickness: about 1,06 mm

The testing laboratory is not provided with further details concerning composition of the tested building materials. Samples are deposited.

2. Preparation of samples

The samples were kept in climate chamber 23/50 until they reached constant weight.

3. Arrangement of samples mounting: freely suspended

#7224:	flaming side B in warp direction	blue
#8570:	flaming side B in warp direction	blue
#8571:	flaming side A in weft direction	blue
#8578:	flaming side B in weft direction	white
#8579:	flaming side B in weft direction	red

4. Date of test CW 02 and CW 49 in 2024

5. Results The test has been examined according to DIN 4102 (Mai 1998)

line no.	Measurement		Result with the tested specimen					Dim.																			
	Test number	flaming direction / side	colour of fabric	Number of specimen arrangement acc. to. DIN 4102/T15, schedule 1	Maximum flame height above bottom edge of the specimen	Time ¹⁾	Burn through / melting		Observations on the back side of the specimen	Flames / Glowing	Time ¹⁾	Falling of burning droplets	Start ¹⁾	Extent	sporadic falling of burning droplets ²⁾	continuous falling of burning droplets ²⁾	After flame time at the bottom of the sieve (max.)	Impairment of the burner by dropping or falling material:	Time ¹⁾	Premature end of test	Final occurrence of burning at the specimen ¹⁾	Time of eventually end of test ¹⁾	After flame after end of test	Time ¹⁾	Number of specimen	Front side of specimen ²⁾	Back side of specimen ²⁾
1	#7224	warp / B	blue	1	30	0:02	0:06	0:06	Flames / Glowing	Time ¹⁾	Falling of burning droplets	Start ¹⁾	Extent	sporadic falling of burning droplets ²⁾	continuous falling of burning droplets ²⁾	After flame time at the bottom of the sieve (max.)	Impairment of the burner by dropping or falling material:	Time ¹⁾	Premature end of test	Final occurrence of burning at the specimen ¹⁾	Time of eventually end of test ¹⁾	After flame after end of test	Time ¹⁾	Number of specimen	Front side of specimen ²⁾	Back side of specimen ²⁾	flame length
2	#8570	warp / A	blue	1	30	0:02	0:06	0:06	Flames / Glowing	Time ¹⁾	Falling of burning droplets	Start ¹⁾	Extent	sporadic falling of burning droplets ²⁾	continuous falling of burning droplets ²⁾	After flame time at the bottom of the sieve (max.)	Impairment of the burner by dropping or falling material:	Time ¹⁾	Premature end of test	Final occurrence of burning at the specimen ¹⁾	Time of eventually end of test ¹⁾	After flame after end of test	Time ¹⁾	Number of specimen	Front side of specimen ²⁾	Back side of specimen ²⁾	flame length
3	#8571	welt / A	white	1	30	0:02	0:06	0:07	Flames / Glowing	Time ¹⁾	Falling of burning droplets	Start ¹⁾	Extent	sporadic falling of burning droplets ²⁾	continuous falling of burning droplets ²⁾	After flame time at the bottom of the sieve (max.)	Impairment of the burner by dropping or falling material:	Time ¹⁾	Premature end of test	Final occurrence of burning at the specimen ¹⁾	Time of eventually end of test ¹⁾	After flame after end of test	Time ¹⁾	Number of specimen	Front side of specimen ²⁾	Back side of specimen ²⁾	flame length
4	#8578	welt / B	white	1	30	0:02	0:06	0:05	Flames / Glowing	Time ¹⁾	Falling of burning droplets	Start ¹⁾	Extent	sporadic falling of burning droplets ²⁾	continuous falling of burning droplets ²⁾	After flame time at the bottom of the sieve (max.)	Impairment of the burner by dropping or falling material:	Time ¹⁾	Premature end of test	Final occurrence of burning at the specimen ¹⁾	Time of eventually end of test ¹⁾	After flame after end of test	Time ¹⁾	Number of specimen	Front side of specimen ²⁾	Back side of specimen ²⁾	flame length
5	#8579	welt / B	red	1	30	0:02	0:06	0:05	Flames / Glowing	Time ¹⁾	Falling of burning droplets	Start ¹⁾	Extent	sporadic falling of burning droplets ²⁾	continuous falling of burning droplets ²⁾	After flame time at the bottom of the sieve (max.)	Impairment of the burner by dropping or falling material:	Time ¹⁾	Premature end of test	Final occurrence of burning at the specimen ¹⁾	Time of eventually end of test ¹⁾	After flame after end of test	Time ¹⁾	Number of specimen	Front side of specimen ²⁾	Back side of specimen ²⁾	flame length

line no.	Measurement	Test number	flaming direction / side	Time ¹⁾	Number of specimen	Place of appearance	Lower half of the specimen ²⁾	Upper half of the specimen ²⁾	Front side of specimen ²⁾	Back side of specimen ²⁾	Density of smoke	≤ 400 % * min	> 400 % * min ⁴⁾	Diagram: encl. no.	Residual lengths: individual value ³⁾	Specimen 1	Specimen 2	Specimen 3	Specimen 4	Average value, individual test ³⁾	Photo of specimen in enclosure no.	33	34	35	36	37
Result with the tested specimen		#7224	warp / B	. / .	. / .	. / .	. / .	. / .	. / .	. / .	1	1	. / .	1	73	73	71	69	74	71	1	Photo of specimen in enclosure no.	Flue gas temperature	Maximum of average value	Diagram: encl. no.	Remarks: - none -
Result with the tested specimen		#8570	warp / A	. / .	. / .	. / .	. / .	. / .	. / .	. / .	1	1	. / .	2	70	71	68	67	69	71	2	Photo of specimen in enclosure no.	Flue gas temperature	Maximum of average value	Diagram: encl. no.	Remarks: - none -
Result with the tested specimen		#8571	welt / A	. / .	. / .	. / .	. / .	. / .	. / .	. / .	1	1	. / .	3	64	62	65	66	64	64	3	Photo of specimen in enclosure no.	Flue gas temperature	Maximum of average value	Diagram: encl. no.	Remarks: - none -
Result with the tested specimen		#8578	welt / B	. / .	. / .	. / .	. / .	. / .	. / .	. / .	1	1	. / .	4	69	68	72	69	70	70	4	Photo of specimen in enclosure no.	Flue gas temperature	Maximum of average value	Diagram: encl. no.	Remarks: - none -
Result with the tested specimen		#8579	welt / B	. / .	. / .	. / .	. / .	. / .	. / .	. / .	1	1	. / .	5	63	64	67	61	64	64	5	Photo of specimen in enclosure no.	Flue gas temperature	Maximum of average value	Diagram: encl. no.	Remarks: - none -

¹⁾ indication of times: from the begin of testing procedure ²⁾ checked off if applicable
³⁾ indication of carrier/foam layer separated in case of fire-proofing agents
⁴⁾ very strong development of smoke



6. Explanations concerning the testing procedure

There were no additional tests proceeded because of the residual length of more than 45 cm.

7. Summary of results and additional establishments to Fire Behaviour

dimen sion	Result with the tested specimen					test-no.	lineno.	measurement
	#8578 weft / B	#8578 weft / B	#8571 weft / A	#8570 warp / A	#7224 warp / B			
	red	white	blue					colour of fabric
cm	64	70	64	69	71			residual length
°C	116	117	115	110	117			max. smoke temperature
%min	1	1	1	1	1			density of smoke - integral
								4 remarks: -none-

According to DIN 4102, part 1, "schwerentflammbare" (hardly flammable) building materials must meet the requirements of class B2.

Pursuant to additional tests in the ignitability apparatus this can be determined (appendix 6 & 7).

8. Special remarks

- This report is only valid for the material as described under paragraph 1. In combination with other materials or with additional coatings or grounds etc. the burning behaviour may differ.
- This test report is not valid for the exposure to outdoor climate conditions, washing or cleaning with chemicals, washing or cleaning with chemicals.
- This test report is not valid, as soon as the fabric is used as a building product in the sense of the "Landesbauordnungen" (state building requirements, MBO § 17, par. 3).
- This test report is no substitute for a General Building Inspectorate Certificate.
- This test report is granted without prejudice to the rights of third parties, in particular private proprietary rights.
- For legal interests only the German original version is relevant.
- In General Building Inspectorates procedures this test report can be based for
- regular building materials for the required proof of accordance
- for not regular building materials for the required proof of applicability

9. Validity

This test report is valid until the mentioned date on page 1. The test report becomes invalid in case the standards on which the tests are based are changed.

Fladungen, 09.12.2024

clerk in charge:

(Handwritten signature in blue ink)


(Dipl.-Ing. (FH) Jürgen Hammer)




Head of the test laboratory:


(Handwritten signature in red ink)

(Dipl.-Ing. (FH) Andreas Hoch)

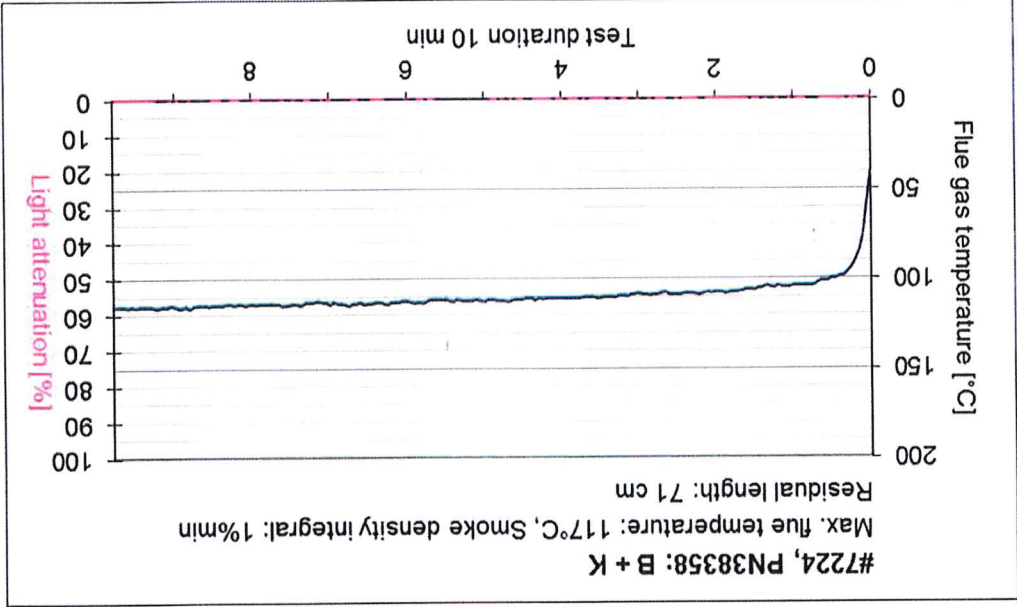



measurement

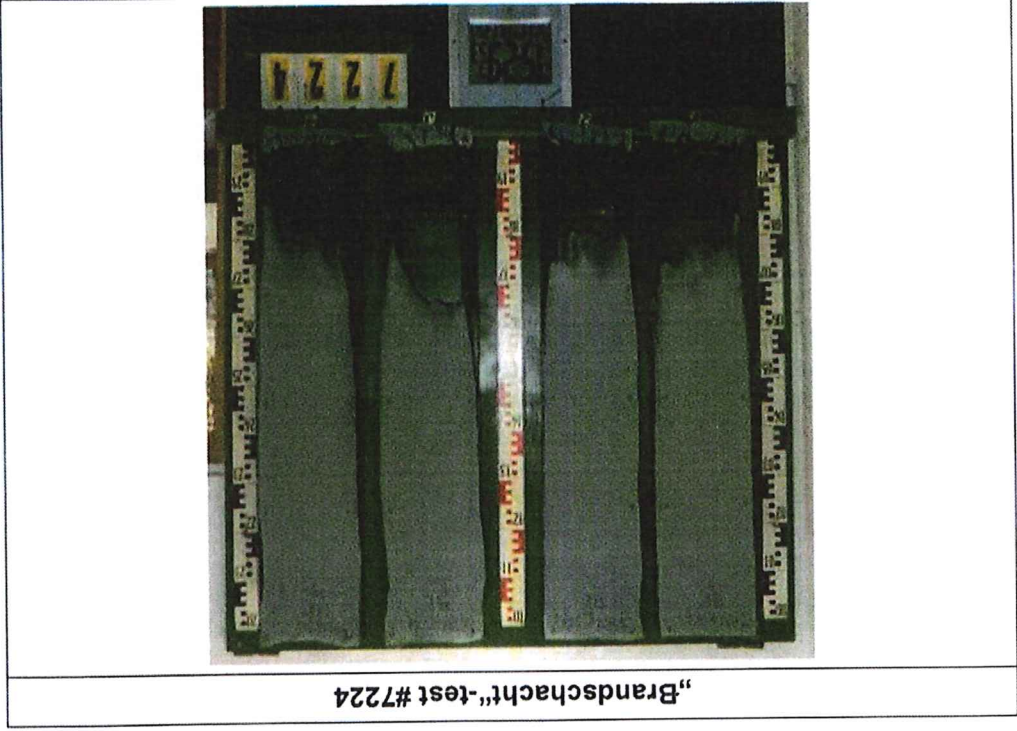

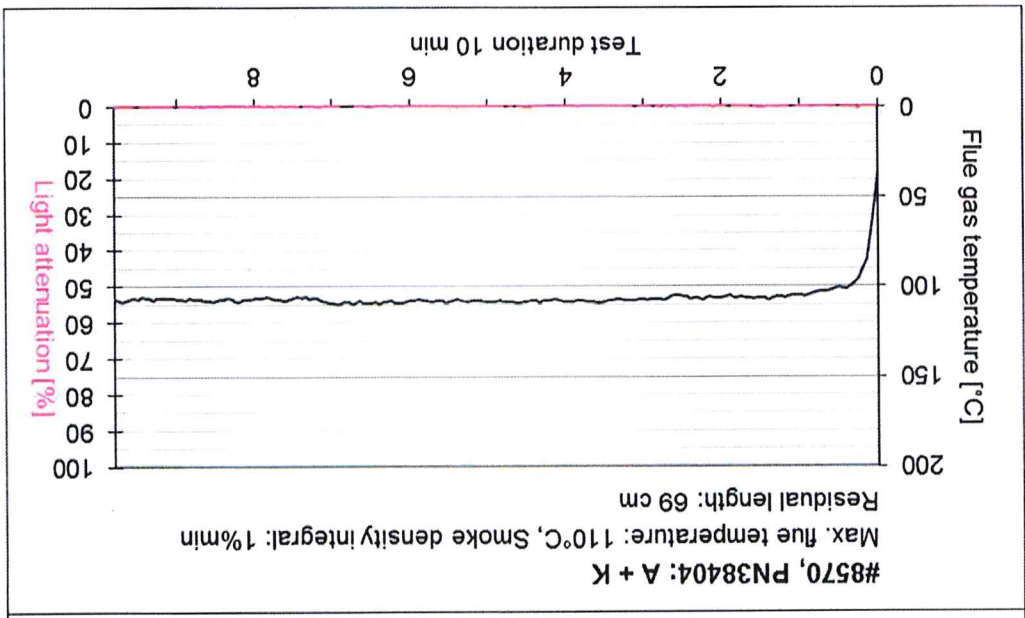


measurement

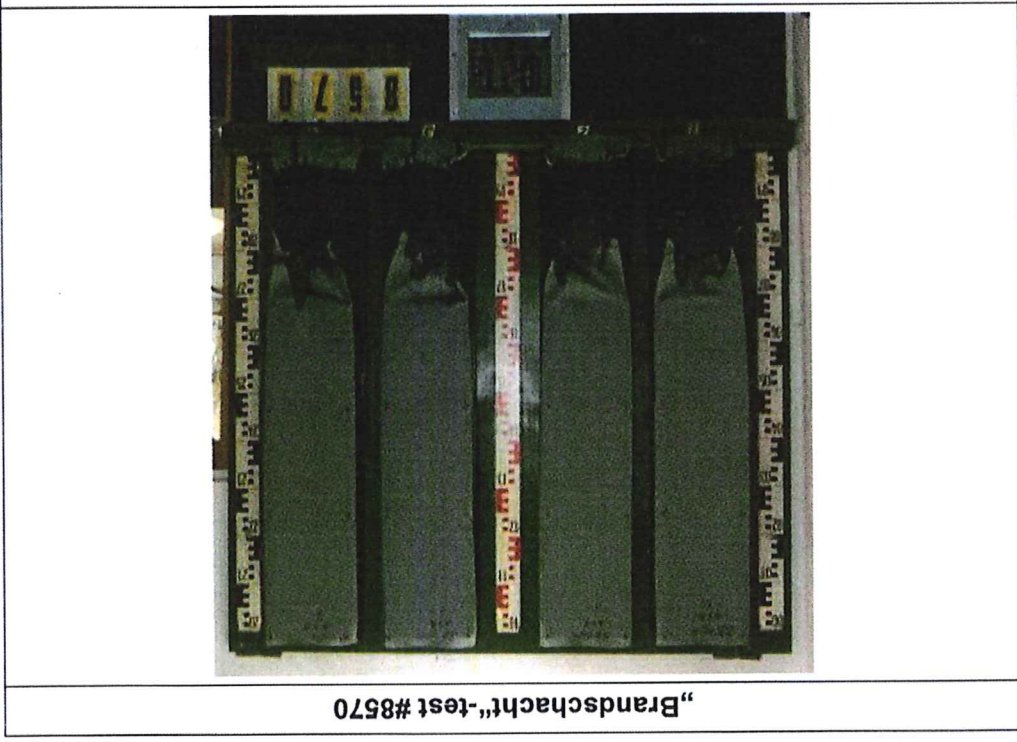


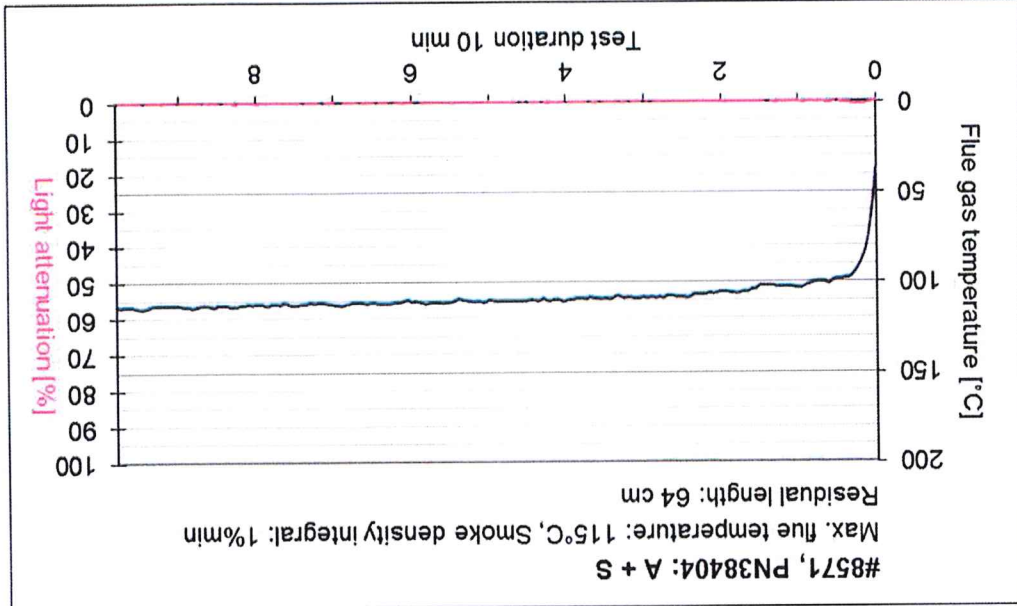


measurement

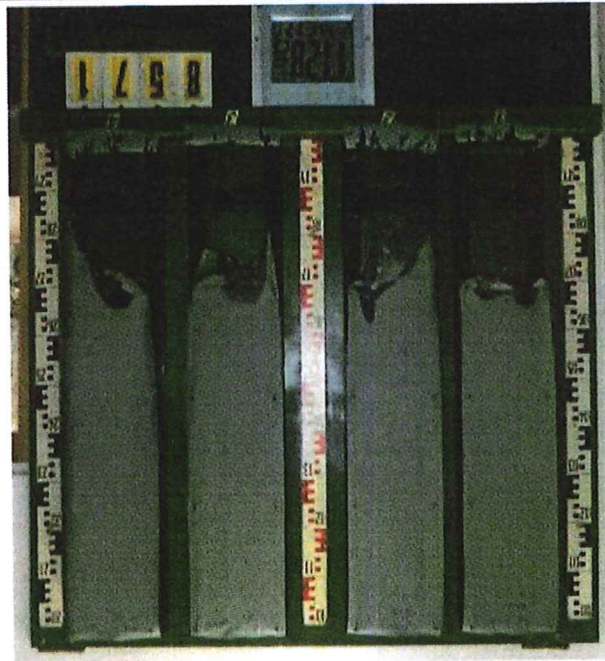


„Brandschacht“-test #8571

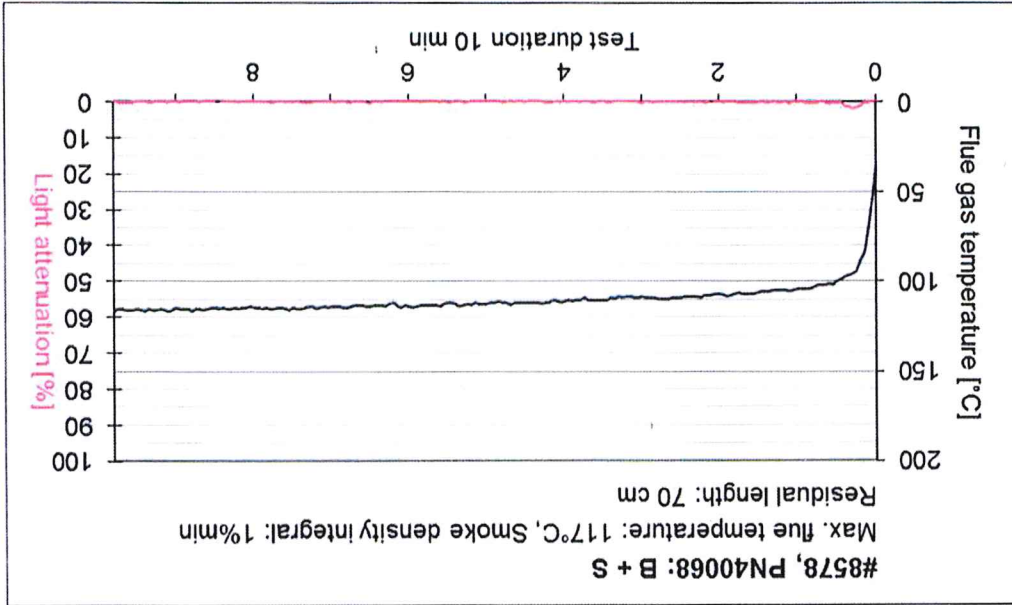


measurement

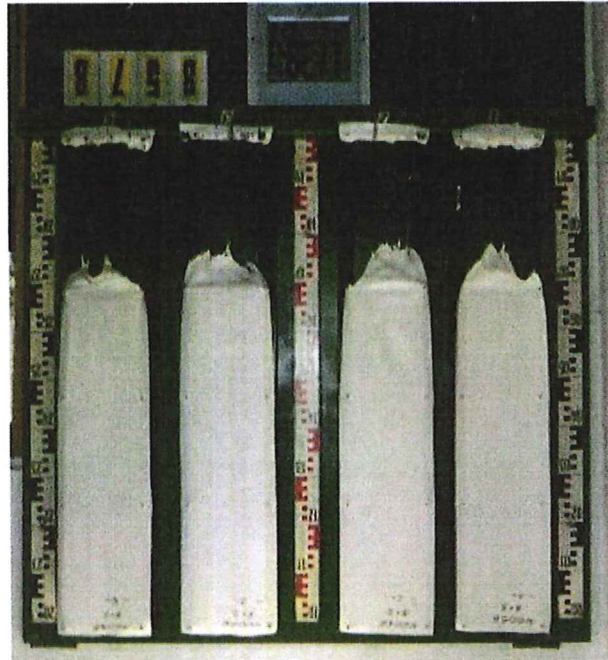


„Brandschacht“-test #8578

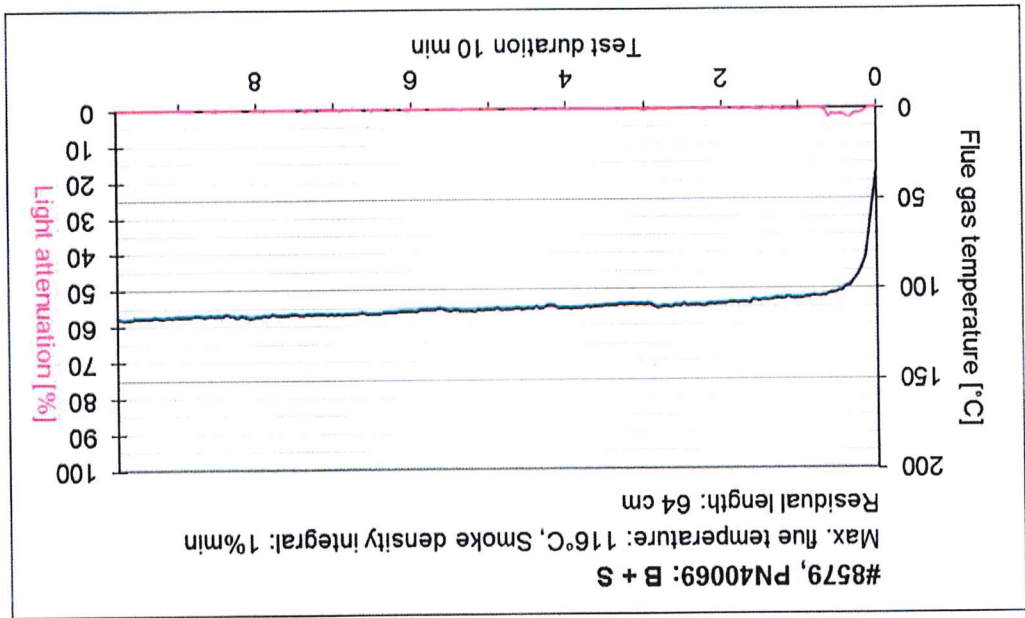

measurement

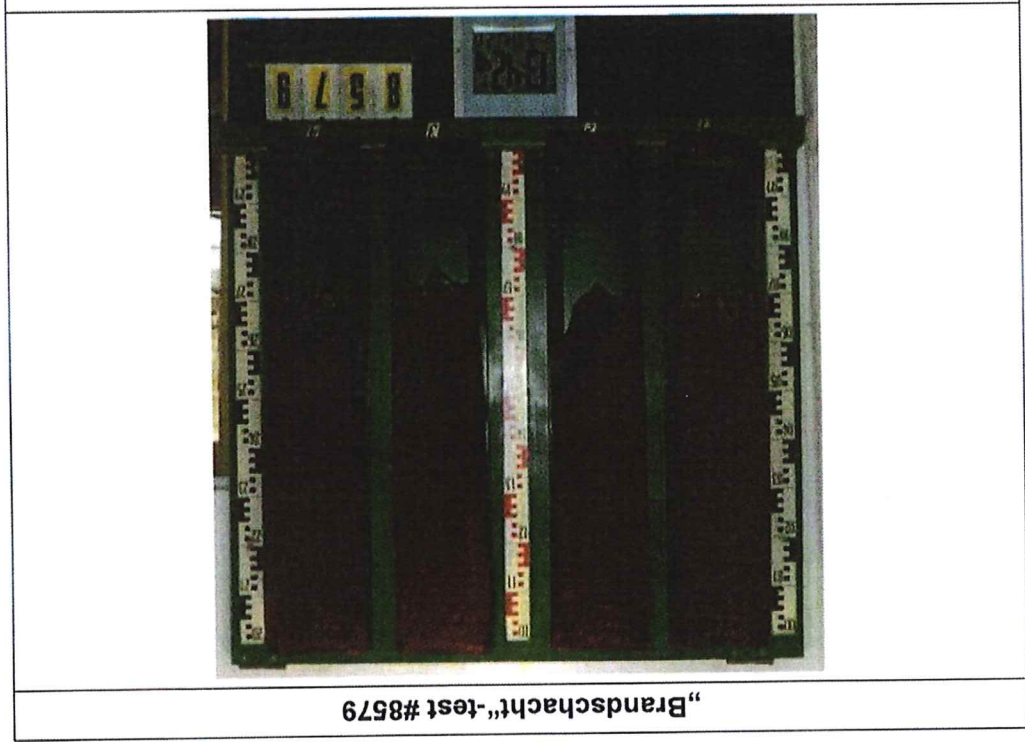



Prüfinsitut Hoch
Lerchenweg 1
D-97650 Fladungen

enclosure 6 test report
PZ-Hoch-241603

**Test for normal flammability
classifying B2 according to DIN 4102**

1. Description of test material in condition as delivered look at page 2

2. Preparation of samples

Out of the material there have been cut samples for the ignitability apparatus.
The samples were kept in a climate 23/50 until they reached constant weight.

3. Arrangement of samples -freely suspended-

Framing in warp and in weft direction / Framing side A and side B

4. Date of test

CW 51 in 2023 and CW 48 in 2024

5. Results

PN 40069: flaming side B in warp direction		surface-test						edge-test										
samples no.	1	2	3	4	5	6	1	2	3	4	5	6	1	2	3	4	5	6
ignition ⁽¹⁾	3	3	3	3	3	3	1	--	--	--	--	--	1	--	--	--	--	--
reaching the mark of measurement ⁽²⁾	/.	/.	/.	/.	/.	/.	/.	--	--	--	--	--	/.	--	--	--	--	--
max. flame height	8	10	8	12	12	12	12	--	--	--	--	--	12	--	--	--	--	--
time	12	15	10	20	20	20	10	--	--	--	--	--	10	--	--	--	--	--
self cessation of the flames end of afterflame ⁽¹⁾	15	18	14	25	58	31	31	--	--	--	--	--	31	--	--	--	--	--
end of glowing ⁽¹⁾	/.	/.	/.	/.	/.	/.	/.	--	--	--	--	--	/.	--	--	--	--	--
flames were extinguished after ⁽¹⁾	/.	/.	/.	/.	/.	/.	/.	--	--	--	--	--	/.	--	--	--	--	--
smoke development (visual)	heavy						heavy											
dropping of burning material during 20 s ⁽¹⁾	/.	/.	/.	/.	/.	/.	/.	--	--	--	--	--	/.	--	--	--	--	--
Appearance after test: burned out till max. height 16 cm x width 5 cm																		

PN 40069: additional tests		edge-test						surface-test										
samples no.	1	2	3	4	5	6	1	2	3	4	5	6	1	2	3	4	5	6
arrangement of samples side / direction	A/K	A/S	B/S	--	--	--	A/K	A/S	B/S	--	--	--	A/K	A/S	B/S	--	--	--
ignition ⁽¹⁾	1	1	1	--	--	--	3	3	3	--	--	--	3	3	3	--	--	--
reaching the mark of measurement ⁽²⁾	/.	/.	/.	--	--	--	/.	/.	/.	--	--	--	/.	/.	/.	--	--	--
max. flame height	10	8	8	--	--	--	12	6	7	--	--	--	12	6	7	--	--	--
time	10	10	10	--	--	--	20	10	15	--	--	--	20	10	15	--	--	--
self cessation of the flames end of afterflame ⁽¹⁾	14	14	12	--	--	--	56	15	18	--	--	--	56	15	18	--	--	--
end of glowing ⁽¹⁾	/.	/.	/.	--	--	--	/.	/.	/.	--	--	--	/.	/.	/.	--	--	--
flames were extinguished after ⁽¹⁾	/.	/.	/.	--	--	--	/.	/.	/.	--	--	--	/.	/.	/.	--	--	--
smoke development (visual)	heavy						heavy											
dropping of burning material during 20 s ⁽¹⁾	/.	/.	/.	--	--	--	/.	/.	/.	--	--	--	/.	/.	/.	--	--	--
Appearance after test: burned out till max. height 16 cm x width 5 cm																		

⁽¹⁾ time mentioned from the beginning of the test ⁽²⁾ during 20 Sec -/- no appearance -- no information
K: warp / S: weft



PrüfInstitut Hoch
 Lerchenweg 1
 D-97650 Fladungen

enclosure 7 to test report
 PZ-Hoch-241603

Dim	PN 40068: additional tests						edge-test						surface-test					
	1	2	3	4	5	6	1	2	3	4	5	6	1	2	3	4	5	6
samples no.	1	2	3	4	5	6	1	2	3	4	5	6	1	2	3	4	5	6
arrangement of samples side / direction	A/K	B/K	A/S	B/S	--	--	A/K	B/K	A/S	B/S	--	--	A/K	B/K	A/S	B/S	--	--
ignition ⁽¹⁾	1	1	1	1	1	1	1	1	1	1	1	1	3	3	3	3	3	3
reaching the mark of measurement ⁽²⁾	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.
max. flame height	4	4	7	5	8	6	4	7	5	5	8	6	10	4	4	4	4	4
time	6	6	5	15	8	6	6	5	15	8	6	6	15	20	4	4	4	4
self cessation of the flames end of afterflame ⁽¹⁾	8	7	18	10	10	8	17	18	10	10	17	17	17	60	6	6	6	6
end of glowing ⁽¹⁾	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.
flames were extinguished after ⁽¹⁾	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.
smoke development (visual)	dropping of burning material during 20 s ⁽¹⁾						moderate						heavy					
dropping of burning material during 20 s ⁽¹⁾	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.
Appearance after test: burned out till max. height 16 cm x width 4 cm																		

Dim	PN 38404: additional tests						edge-test						surface-test					
	1	2	3	4	5	6	1	2	3	4	5	6	1	2	3	4	5	6
samples no.	1	2	3	4	5	6	1	2	3	4	5	6	1	2	3	4	5	6
arrangement of samples side / direction	A/K	B/K	A/S	B/S	--	--	A/K	B/K	A/S	B/S	--	--	A/K	B/K	A/S	B/S	--	--
ignition ⁽¹⁾	1	1	1	1	1	1	1	1	1	1	1	1	4	3	3	3	5	5
reaching the mark of measurement ⁽²⁾	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.
max. flame height	5	5	4	4	4	5	5	4	4	4	4	5	3	4	4	3	3	3
time	10	3	5	4	4	10	10	3	5	4	4	10	9	7	7	4	9	9
self cessation of the flames end of afterflame ⁽¹⁾	12	5	7	6	6	12	12	5	7	6	6	12	9	10	9	12	12	12
end of glowing ⁽¹⁾	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.
flames were extinguished after ⁽¹⁾	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.
smoke development (visual)	dropping of burning material during 20 s ⁽¹⁾						little						little					
dropping of burning material during 20 s ⁽¹⁾	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.
Appearance after test: burned out till max. height 5 cm x width 2 cm																		

⁽¹⁾ time mentioned from the beginning of the test ⁽²⁾ during 20 Sec -/- no appearance -- no information
 K: warp / S: weft

6. Remarks and explanations to the testing procedure - none -

7. Opinion concerning the dropping of burning material

The test for normal flammability shows no burning dripping material