

Test laboratory for the fire behavior of building materials, Dipl.-Ing. (FH) Andreas Hoch
Testing, supervising and certifying body, authorized by the building supervision authority

TEST REPORT

PZ-Hoch-200185

for the proof of Fire behaviour according to DIN 4102, part 1
Translation of the German test report – no guarantee for translation of technical terms

company	Artimo Textiles De Meeten 53 4706 NK Roosendaal The Netherlands
description of samples	fabric consisting of 100% Polyester in 3 different colours
name of the material	VERSATO
sampling	by the company itself
content of request	Proof of flammability to classify building materials to class B1 "schwerentflammbar" according to DIN 4102, part 1
validity of test report	31.01.2025
result	The examined product meets in any colour the requirements of class B1 for "schwerentflammbare" (hardly flammable) building materials according to DIN 4102, part 1 (May 1998), suspended freely or with distance of >40 mm to same or other plain materials. The examined product shows burning droplets.

This test report includes 5 pages and 7 enclosures.

Remark: If the above mentioned building material is not used as product according to MBO § 2, Abs. 9, Ziffer 1, there is no need for a general building supervisory test report.

This test report is not valid if the examined building material is used as product in the meaning of state building prescriptions (MBO § 17, Abs. 3).

This test report does not replace an eventually necessary proof of applicability concerning building supervisory or building laws in the meaning of state building prescriptions. This has to be verified by:

- "allgemeine bauaufsichtliche Zulassung" (general building inspectorate approval) or by
- „allgemeines bauaufsichtliches Prüfzeugnis" (general building inspectorate certificate) or by
- "Zustimmung im Einzelfall" (exceptional approval)

This test report can underlie building supervisory procedures

- for regular building products for the prescribed proofs of conformity
- for non-regular building products for the needed proofs of applicability.

This test report must not be published and copied without preceding agreement of the test laboratory and if agreed, only during validity and unchanged concerning appearance and contents.

1. Description of test material in condition as delivered

PN 30769: VERSATO colour: white
-fabric consisting of 100% Polyester-
side A: smoother surface
characteristic values determined by the test laboratory:
area weight: about 313 g/m² thickness: about 1,2 mm

PN 30770: VERSATO colour: red
-fabric consisting of 100% Polyester-
side A: smoother surface
characteristic values determined by the test laboratory:
area weight: about 307 g/m² thickness: about 1,1 mm

PN 30771: VERSATO colour: black
-fabric consisting of 100% Polyester-
side A: smoother surface
characteristic values determined by the test laboratory:
area weight: about 322 g/m² thickness: about 1,2 mm

The testing laboratory is not provided with further details concerning composition of the tested building materials. Samples are deposited.

2. Preparation of samples

The samples were kept in climate chamber 23/50 until they reached constant weight.

3. Arrangement of samples mounting: freely suspended

#3303:	flaming side A in warp direction	black
#3304:	flaming side B in warp direction	black
#3306:	flaming side A in weft direction	black
#3308:	flaming side A in weft direction	red
#3309:	flaming side A in weft direction	white

4. Date of test CW 08 in 2020

5. Results The test has been examined according to DIN 4102 (Mai 1998)

line no.	Measurement	Result with the tested specimen					Dim.
		#3203	#3204	#3206	#3208	#3209	
	Test number	#3203	#3204	#3206	#3208	#3209	
	flaming direction / side	warp / A	weft / B	warp / A	warp / A	warp / A	
	<u>colour of fabric</u>	black			red	white	
1	<u>Number of specimen arrangement</u> acc. to. DIN 4102/T15, schedule 1	1	1	1	1	1	
2	<u>Maximum flame height above bottom</u> edge of the specimen	40	50	40	40	40	cm
3	Time ¹⁾	0:03	0:04	0:04	0:04	0:06	min:s
4	<u>Burn through / melting</u> Time ¹⁾	0:05	0:05	0:05	0:05	0:05	min:s
5	<u>Observations on the back side of the specimen</u> Flames / Glowing Time ¹⁾	./.	./.	./.	./.	./.	min:s
6	Change of colour Time ¹⁾	./.	./.	./.	./.	./.	min:s
7	<u>Falling of burning droplets</u> Start ¹⁾	X 0:08/0:26	X 0:38/1:04	X 0:17/2:21	./.	X 0:19	min:s
8	<u>Extent</u> sporadic falling of burning droplets ²⁾	X	X	X	---	X	
9	continuous falling of burning droplets ²⁾	---	---	---	---	---	min:s
10	<u>Falling of burning droplets</u> Start ¹⁾	./.	./.	./.	./.	./.	min:s
11	Extent	./.	./.	./.	./.	./.	
12	sporadic falling of burning droplets ²⁾	./.	./.	./.	./.	./.	
12	continuous falling of burning droplets ²⁾	./.	./.	./.	./.	./.	
13	<u>After flame time at the bottom of the sieve (max.)</u>	0:15/0:50	0:33/0:25	0:16/0:29	./.	0:08	min:s
14	<u>Impairment of the burner by dropping or falling material:</u> Time ¹⁾	./.	./.	./.	./.	./.	min:s
15	<u>Premature end of test</u> Final occurrence of burning at the specimen ¹⁾	./.	./.	./.	./.	./.	min:s
16	Time of eventually end of test ¹⁾	./.	./.	./.	./.	./.	min:s
17	<u>After flame after end of test</u> Time ¹⁾	./.	./.	./.	./.	./.	min:s
18	Number of specimen	./.	./.	./.	./.	./.	
19	Front side of specimen ²⁾	./.	./.	./.	./.	./.	
20	Back side of specimen ²⁾	./.	./.	./.	./.	./.	
21	flame length	./.	./.	./.	./.	./.	cm

line no.	Measurement	Result with the tested specimen					Dim.
	Test number	#3203	#3204	#3206	#3208	#3209	
	flaming direction / side	warp / A	weft / B	warp / A	warp / A	warp / A	
22	<u>Afterglow after end of test</u> Time ¹⁾	./.	./.	./.	./.	./.	min:s
23	Number of specimen	./.	./.	./.	./.	./.	
	<u>Place of appearance</u>	./.	./.	./.	./.	./.	
24	Lower half of the specimen ²⁾	./.	./.	./.	./.	./.	
25	Upper half of the specimen ²⁾	./.	./.	./.	./.	./.	
26	Front side of specimen ²⁾	./.	./.	./.	./.	./.	
27	Back side of specimen ²⁾	./.	./.	./.	./.	./.	
	<u>Density of smoke</u>						
28	≤ 400 % * min	1	6	1	1	1	% * min
29	> 400 % * min ⁴⁾	./.	./.	./.	./.	./.	% * min
30	Diagram: encl. no.	1	2	3	4	5	
31	<u>Residual lengths: individual value</u> ³⁾						
	Specimen 1	72	72	66	62	70	cm
	Specimen 2	71	71	74	67	70	cm
	Specimen 3	68	70	69	62	63	cm
	Specimen 4	67	66	64	63	69	cm
32	<u>Average value, individual test</u> ³⁾	70	70	68	64	68	
33	<u>Photo of specimen in enclosure no.</u>	1	2	3	4	5	
34	<u>Flue gas temperature</u>	121	118	119	118	119	°C
35	Maximum of average value Time ¹⁾	08:47	09:08	09:42	09:57	09:57	min:s
36	Diagram: encl. no.	1	2	3	4	5	
37	Remarks: - none -						

¹⁾ indication of times: from the begin of testing procedure ²⁾ checked off if applicable

³⁾ indication of carrier/foam layer separated in case of fire-proofing agents

⁴⁾ very strong development of smoke

6. Explanations concerning the testing procedure

There were no additional tests proceeded because of the residual length of more than 45 cm.

7. Summary of results and additional establishments to Fire Behaviour

lineno.	measurement	Result with the tested specimen					dimension
	test-no.	#3303 warp / A	#3304 warp / B	#3306 weft / A	#3308 weft / A	#3309 weft / A	
	<u>colour of fabric</u>	black			red	white	
1	residual length	70	70	68	64	68	cm
2	max. smoke temperature	121	118	119	118	119	°C
3	density of smoke - integral	1	6	1	1	1	%min
4	remarks: During the Brandschacht-tests #3303 and #3304 and #3306 the material showed burning droplets for longer than 20 seconds.						

According to DIN 4102, part 1, "schwerentflammbare" (hardly flammable) building materials must meet the requirements of class B2.

Pursuant to additional tests in the ignitability apparatus this can be determined (appendix 6 & 7).

8. Special remarks


- This report is only valid for the material as described under paragraph 1. In combination with other materials or with additional coatings or grounds etc. the burning behaviour may differ.
- This test report is not valid for the exposure to outdoor climate conditions, washing or cleaning with chemicals, washing or cleaning with chemicals.
- This test report is not valid, as soon as the fabric is used as a building product in the sense of the "Landesbauordnungen" (state building requirements, MBO § 17, par. 3).
- This test report is no substitute for a General Building Inspectorate Certificate.
- This test report is granted without prejudice to the rights of third parties, in particular private proprietary rights.
- For legal interests only the German original version is relevant.
- In General Building Inspectorates procedures this test report can be based for
 - regular building materials for the required proof of accordance
 - for not regular building materials for the required proof of applicability

9. Validity

This test report is valid until the mentioned date on page 1. The test report becomes invalid in case the standards on which the tests are based are changed.

Fladungen, 21.02.2020

clerk in charge:

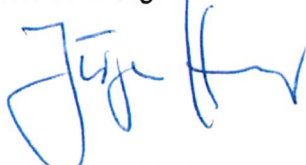

(Dipl.-Ing. (FH) Jürgen Hammer)




Head of the test laboratory:




(Dipl.-Ing.(FH) Andreas Hoch)

„Brandschacht“-test #3303

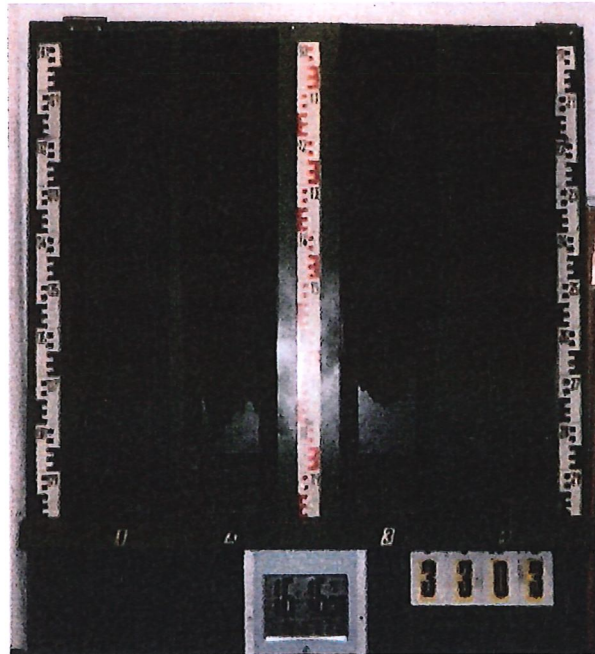


measurement

#3303, PN30771: ARTIMO, "VERSATO", A+S
Max. flue temperature: 121°C, Smoke density integral: 1%/min
Residual length: 70 cm

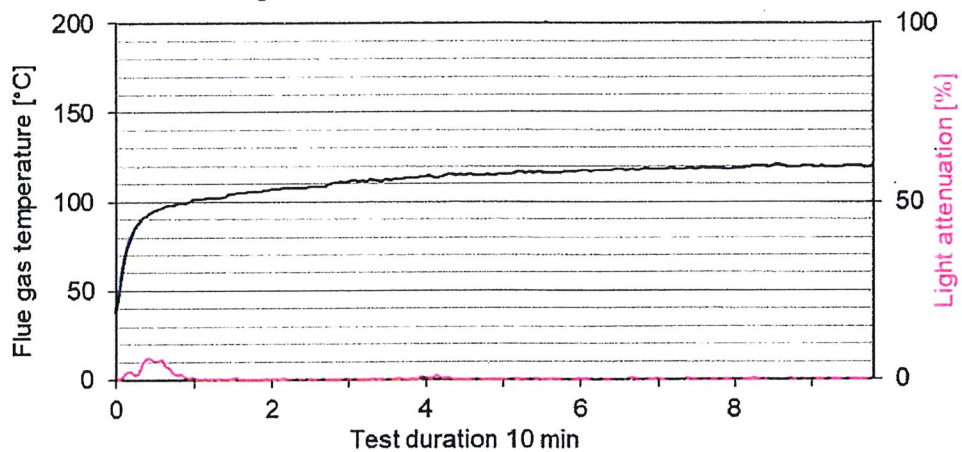


„Brandschacht“-test #3304

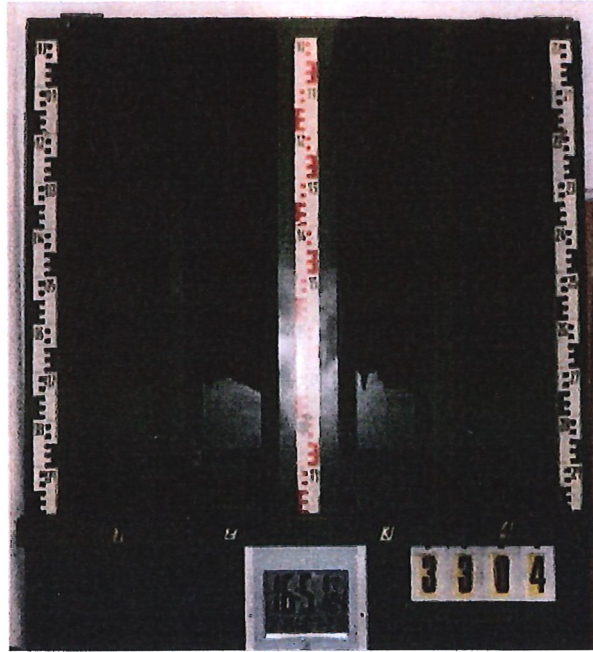


measurement

#3304, PN30771: ARTIMO, "VERSATO", A+S
Max. flue temperature: 118°C, Smoke density integral: 6%/min
Residual length: 70 cm

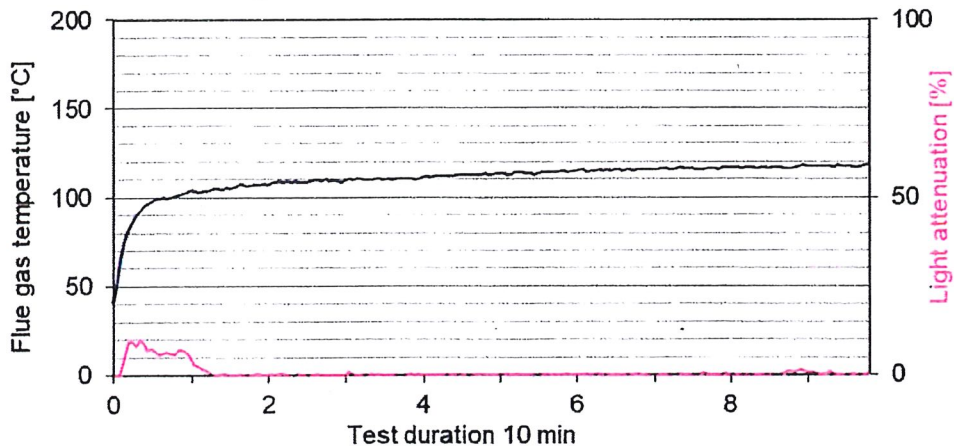


„Brandschacht“-test #3306

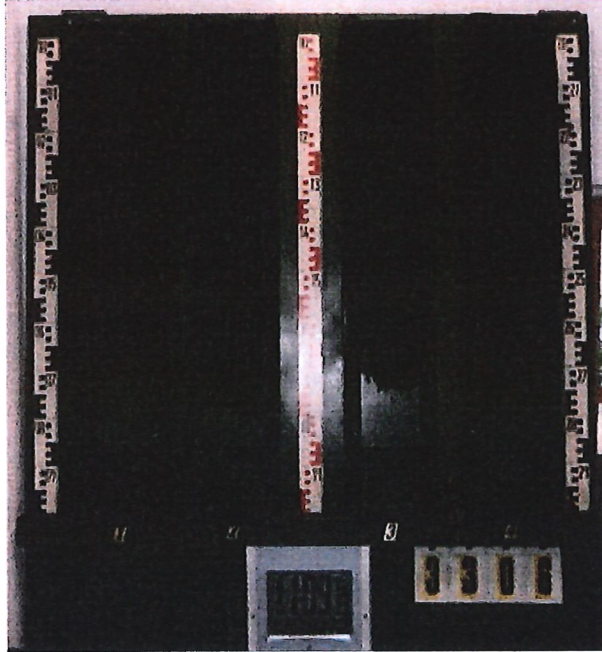


measurement

#3306, PN30771: ARTIMO, "VERSATO", A+S
Max. flue temperature: 119°C, Smoke density integral: 1%/min
Residual length: 68 cm

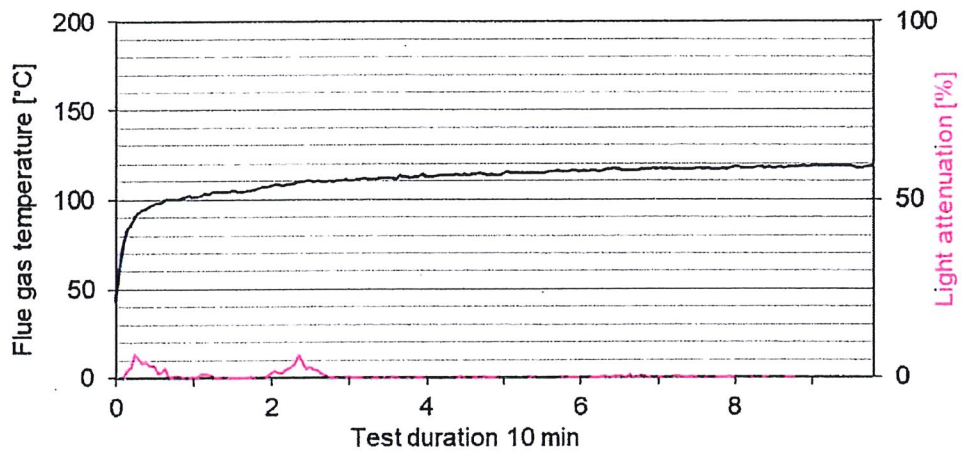


„Brandschacht“-test #3308

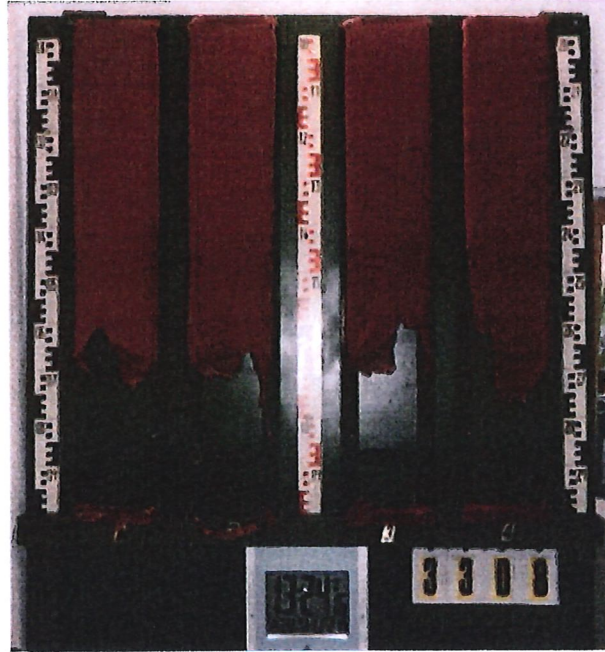


measurement

#3308, PN30770: ARTIMO, "VERSATO", A+S
Max. flue temperature: 118°C, Smoke density integral: 1%/min
Residual length: 64 cm

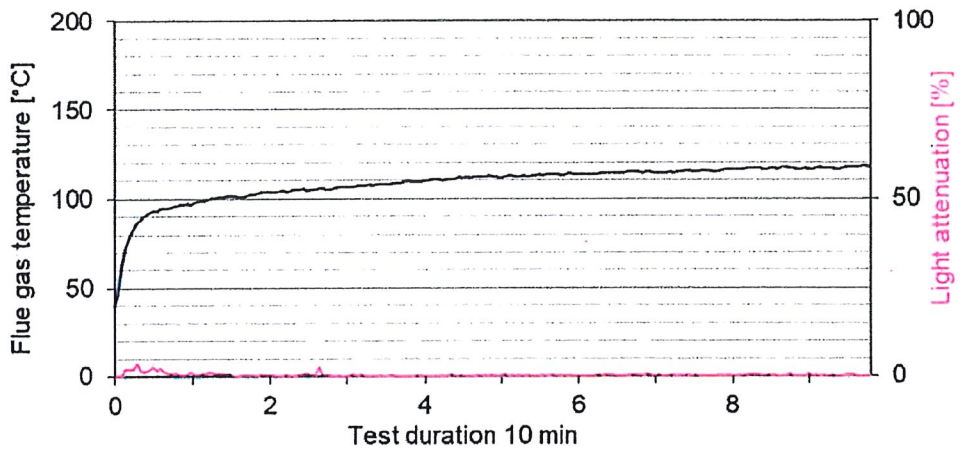

„Brandschacht“-test #3309

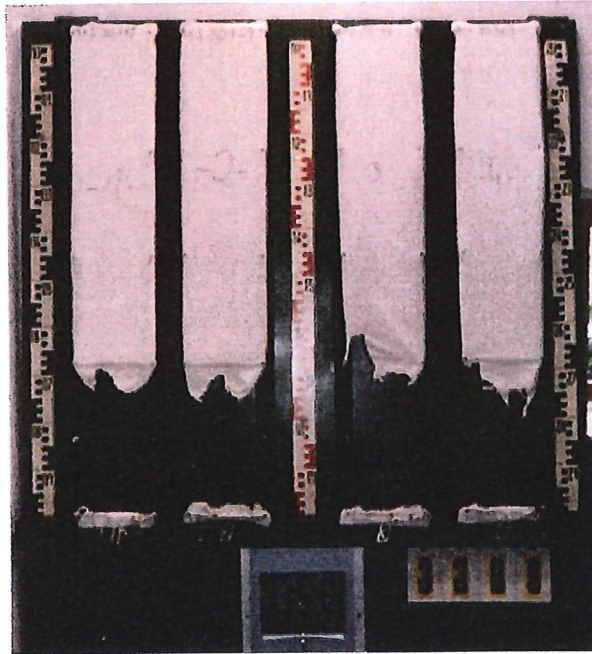


measurement

#3309, PN30769: ARTIMO, "VERSATO", A+S

Max. flue temperature: 119°C, Smoke density integral: 1%/min

Residual length: 68 cm

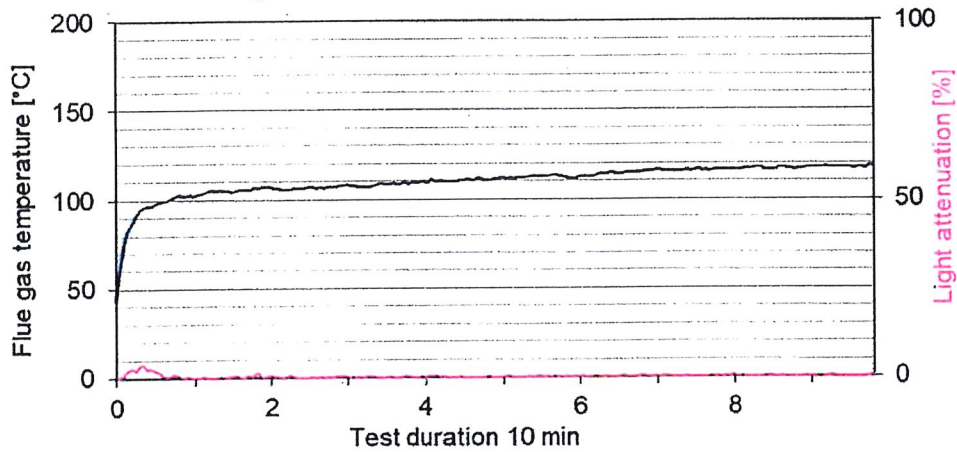

**Test for normal flammability
classifying B2 according to DIN 4102**

1. Description of test material in condition as delivered look at page 2
2. Preparation of samples
Out of the material there have been cut samples for the ignitability apparatus.
The samples were kept in a climate 23/50 until they reached constant weight.
3. Arrangement of samples -freely suspended-
Flaming in warp and in weft direction / Flaming side A and side B
4. Date of test CW 08 in 2020
5. Results

PN 30771: flaming side A in warp direction	edge-test						surface-test						Dim
	1	2	3	4	5	6	1	2	3	4	5	6	
samples no.	1	2	3	4	5	6	1	2	3	4	5	6	
ignition ¹⁾	1	1	1	1	1	--	3	--	--	--	--	--	s
reaching the mark of measurement ¹⁾²⁾	./.	./.	./.	./.	./.	--	./.	--	--	--	--	--	S
max. flame height	13	13	12	12	12	--	12	--	--	--	--	--	cm
time	20	15	15	15	15	--	20	--	--	--	--	--	
self cessation of the flames end of afterflame ¹⁾	43	./.	./.	./.	./.	--	./.	--	--	--	--	--	s
end of glowing ¹⁾	./.	./.	./.	./.	./.	--	./.	--	--	--	--	--	s
flames were extinguished after ¹⁾	./.	25	25	25	25	--	30	--	--	--	--	--	s
smoke development (visual)	heavy						heavy						
dropping of burning material during 20 s ¹⁾	./.	./.	./.	11	./.	--	./.	--	--	--	--	--	s
Appearance after test: burned out till max. height 16 cm x width 9 cm													

PN 30771: additional tests	edge-test						surface-test						Dim
	1	2	3	4	5	6	1	2	3	4	5	6	
samples no.	1	2	3	4	5	6	1	2	3	4	5	6	
ignition ¹⁾	1	1	1	--	--	--	3	3	3	--	--	--	s
reaching the mark of measurement ¹⁾²⁾	./.	./.	./.	--	--	--	./.	./.	./.	--	--	--	s
max. flame height	9	8	9	--	--	--	8	12	8	--	--	--	cm
time	15	15	15	--	--	--	15	20	15	--	--	--	
self cessation of the flames end of afterflame ¹⁾	./.	17	24	--	--	--	30	./.	./.	--	--	--	s
end of glowing ¹⁾	./.	./.	./.	--	--	--	./.	./.	./.	--	--	--	s
flames were extinguished after ¹⁾	./.	./.	./.	--	--	--	./.	25	25	--	--	--	s
smoke development (visual)	heavy						heavy						
dropping of burning material during 20 s ¹⁾	./.	./.	10	--	--	--	./.	./.	./.	--	--	--	s
Appearance after test: burned out till max. height 16 cm x width 9 cm													

¹⁾ time mentioned from the beginning of the test ²⁾ during 20 Sec -/- no appearance -- no information

PN 30770: additional tests	edge-test						surface-test						Dim
	1	2	3	4	5	6	1	2	3	4	5	6	
samples no.	1	2	3	4	5	6	1	2	3	4	5	6	
ignition ¹⁾	1	1	1	1	--	--	3	3	3	3	--	--	s
reaching the mark of measurement ¹⁾²⁾	./.	./.	./.	./.	--	--	./.	./.	./.	./.	--	--	s
max. flame height	7	11	7	7	--	--	11	10	4	6	--	--	cm
time	15	20	12	10	--	--	20	15	15	15	--	--	
self cessation of the flames end of afterflame ¹⁾	17	./.	14	12	--	--	./.	./.	15	30	--	--	s
end of glowing ¹⁾	./.	./.	./.	./.	--	--	./.	./.	./.	./.	--	--	s
flames were extinguished after ¹⁾	./.	30	./.	./.	--	--	25	25	./.	./.	--	--	s
smoke development (visual)	moderate-heavy						moderate-heavy						
dropping of burning material during 20 s ¹⁾	./.	./.	./.	./.	--	--	./.	./.	./.	./.	--	--	s
Appearance after test: burned out till max. height 13 cm x width 8 cm													

PN 30769: additional tests	edge-test						surface-test						Dim
	1	2	3	4	5	6	1	2	3	4	5	6	
samples no.	1	2	3	4	5	6	1	2	3	4	5	6	
ignition ¹⁾	1	1	1	1	--	--	3	3	3	3	--	--	s
reaching the mark of measurement ¹⁾²⁾	./.	./.	./.	./.	--	--	./.	./.	./.	./.	--	--	s
max. flame height	8	9	9	7	--	--	10	7	4	6	--	--	cm
time	10	11	12	10	--	--	20	15	6	15	--	--	
self cessation of the flames end of afterflame ¹⁾	12	20	13	12	--	--	./.	15	15	15	--	--	s
end of glowing ¹⁾	./.	./.	./.	./.	--	--	./.	./.	./.	./.	--	--	s
flames were extinguished after ¹⁾	./.	./.	./.	./.	--	--	25	./.	./.	./.	--	--	s
smoke development (visual)	heavy						heavy						
dropping of burning material during 20 s ¹⁾	./.	./.	./.	./.	--	--	./.	./.	./.	./.	--	--	s
Appearance after test: burned out till max. height 10 cm x width 7 cm													

¹⁾ time mentioned from the beginning of the test ²⁾ during 20 Sec -/ - no appearance -- no information

6. Remarks and explanations to the testing procedure - none –

7. Opinion concerning the dropping of burning material

The test for normal flammability shows burning dripping material.